

### Legend

Order Limits

Date: 19/05/2020  
 Created by: MS  
 Checked by: TD  
 Doc no: 10872-0136-21  
 Scale: A1@ 1:10,000  
 Reference System: OSGB36  
 Projection: BNG

N  
 0 100 200 300 400 500 600 700 800 900 1,000 Metres


| Rev | Date | Remark |
|-----|------|--------|
|     |      |        |

APFP Regulations Reference: 5(2)(j)  
 Application Document Number: A2.3

## Thurrock Flexible Generation Plant Work Plans Index Sheet





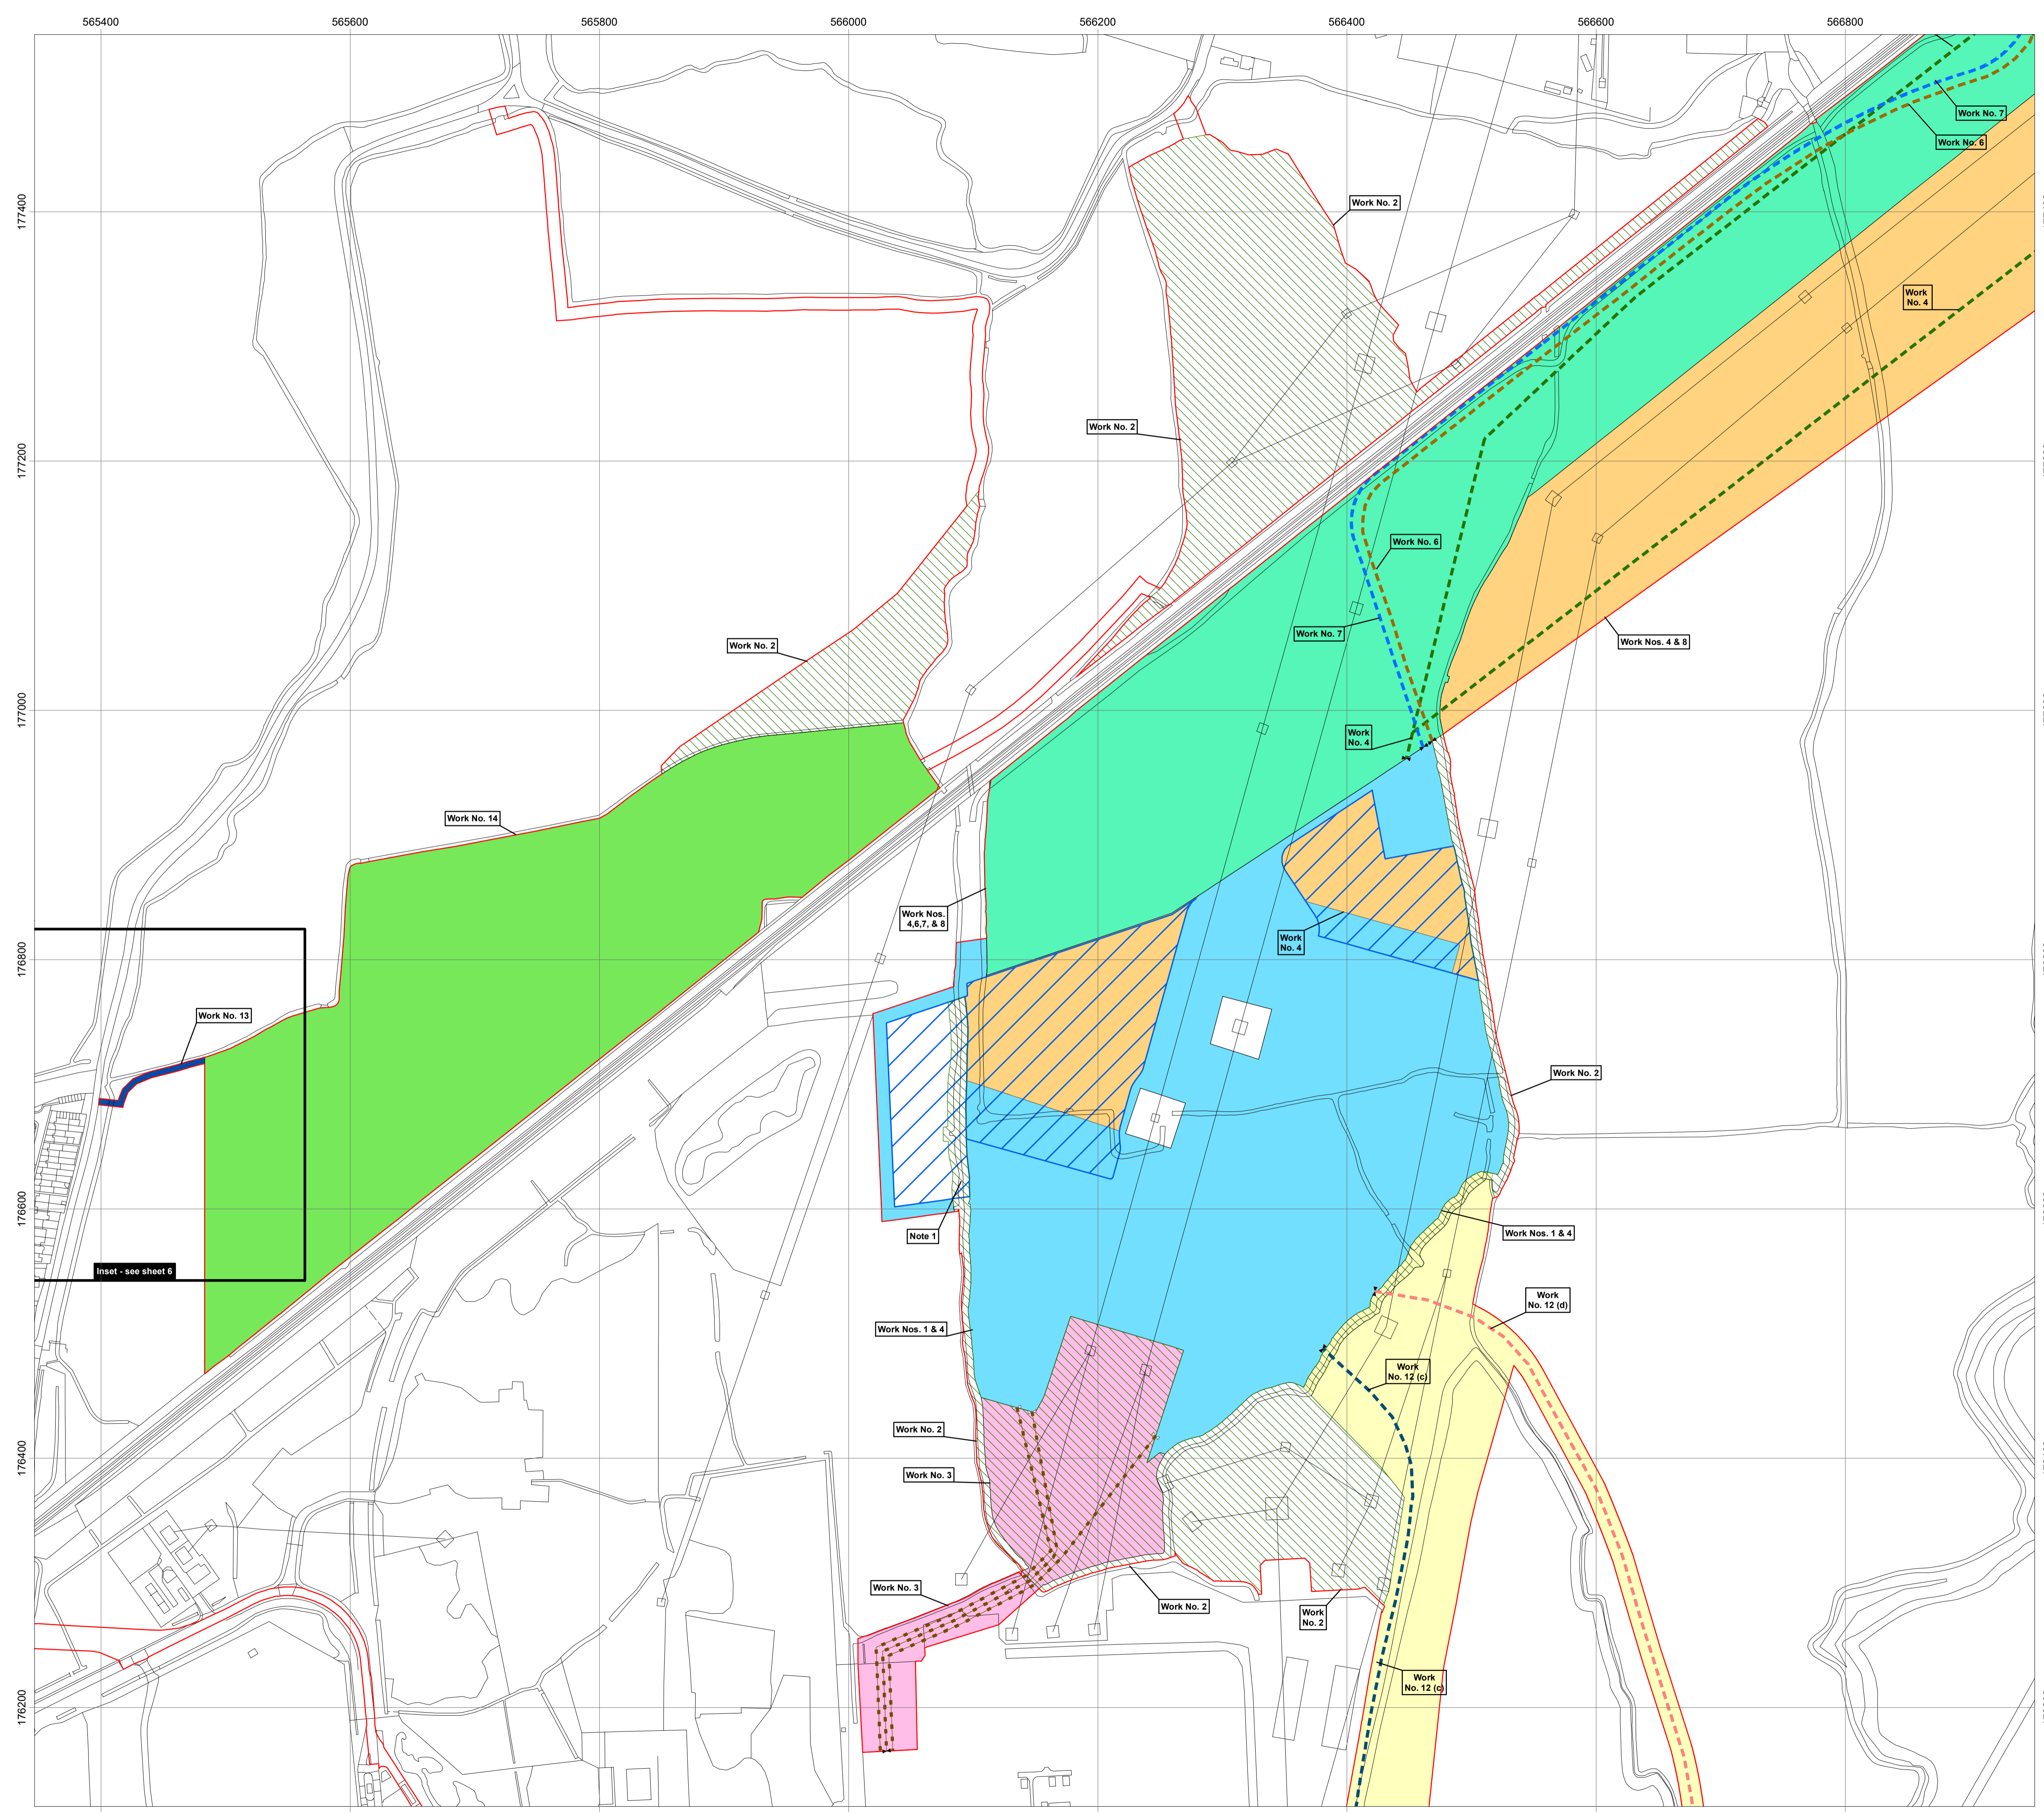

### Legend

- Order Limits
- Work No. 3A indicative centreline
- Work No. 4 indicative centreline
- Work No. 6 indicative centreline
- Work No. 7 indicative centreline
- Work No. 12 (c) indicative centreline
- Work No. 12 (d) indicative centreline
- Start of linear work
- End of linear work
- Work No. 1 and Work No. 4 limit of deviation
- Work No. 2
- Work No. 3 limit of deviation
- Work No. 4 limit of deviation, Work No. 6 limit of deviation, Work No. 7 limit of deviation and Work No. 8
- Work No. 4 limit of deviation and Work No. 8
- Work No. 12 limit of deviation
- Work No. 13
- Work No. 14
- Land for carbon capture readiness (CCR)

Note 1: Ditch to be retained unless CCR land is developed.

Date: 19/05/2020  
 Created by: MS  
 Checked by: TD  
 Doc no: 10872-0136-21  
 Scale: A1@ 1:2,500  
 Reference System: OSGB36  
 Projection: BNG



| Rev | Date | Remark |
|-----|------|--------|
|     |      |        |

APFP Regulations Reference: 5(2)(j)  
 Application Document Number: A2.3

## Thurrock Flexible Generation Plant Work Plans Sheet 2 of 6









### Legend

- Order Limits
- Work No. 4 indicative centreline
- Work No. 6 indicative centreline
- Work No. 7 indicative centreline
- Start of linear work
- National Grid gas pipeline Feeder 18
- Work No. 4
- Work No. 4 limit of deviation and Work No. 5
- Work No. 4 limit of deviation, Work No. 6 limit of deviation, Work No. 7 limit of deviation and Work No. 8
- Work No. 4 limit of deviation and Work No. 8

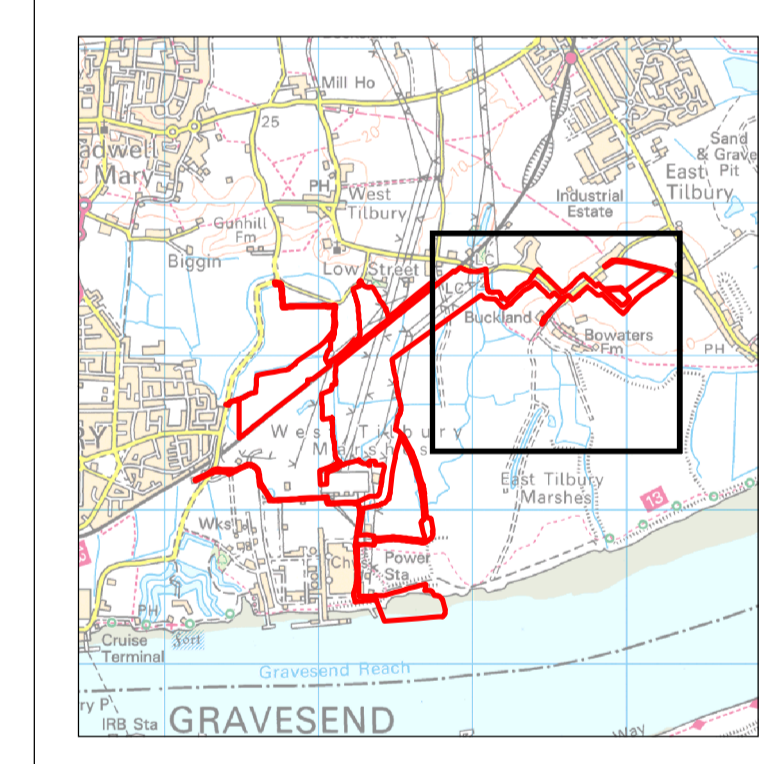

Date: 19/05/2020  
 Created by: MS  
 Checked by: TD  
 Doc no: 10872-0136-21  
 Scale: A1@ 1:2,500  
 Reference System: OSGB36  
 Projection: BNG

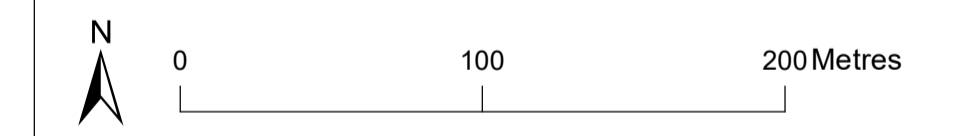


| Rev | Date | Remark |
|-----|------|--------|
|     |      |        |

APFP Regulations Reference: 5(2)(j)  
 Application Document Number: A2.3

### Thurrock Flexible Generation Plant Work Plans Sheet 3 of 6





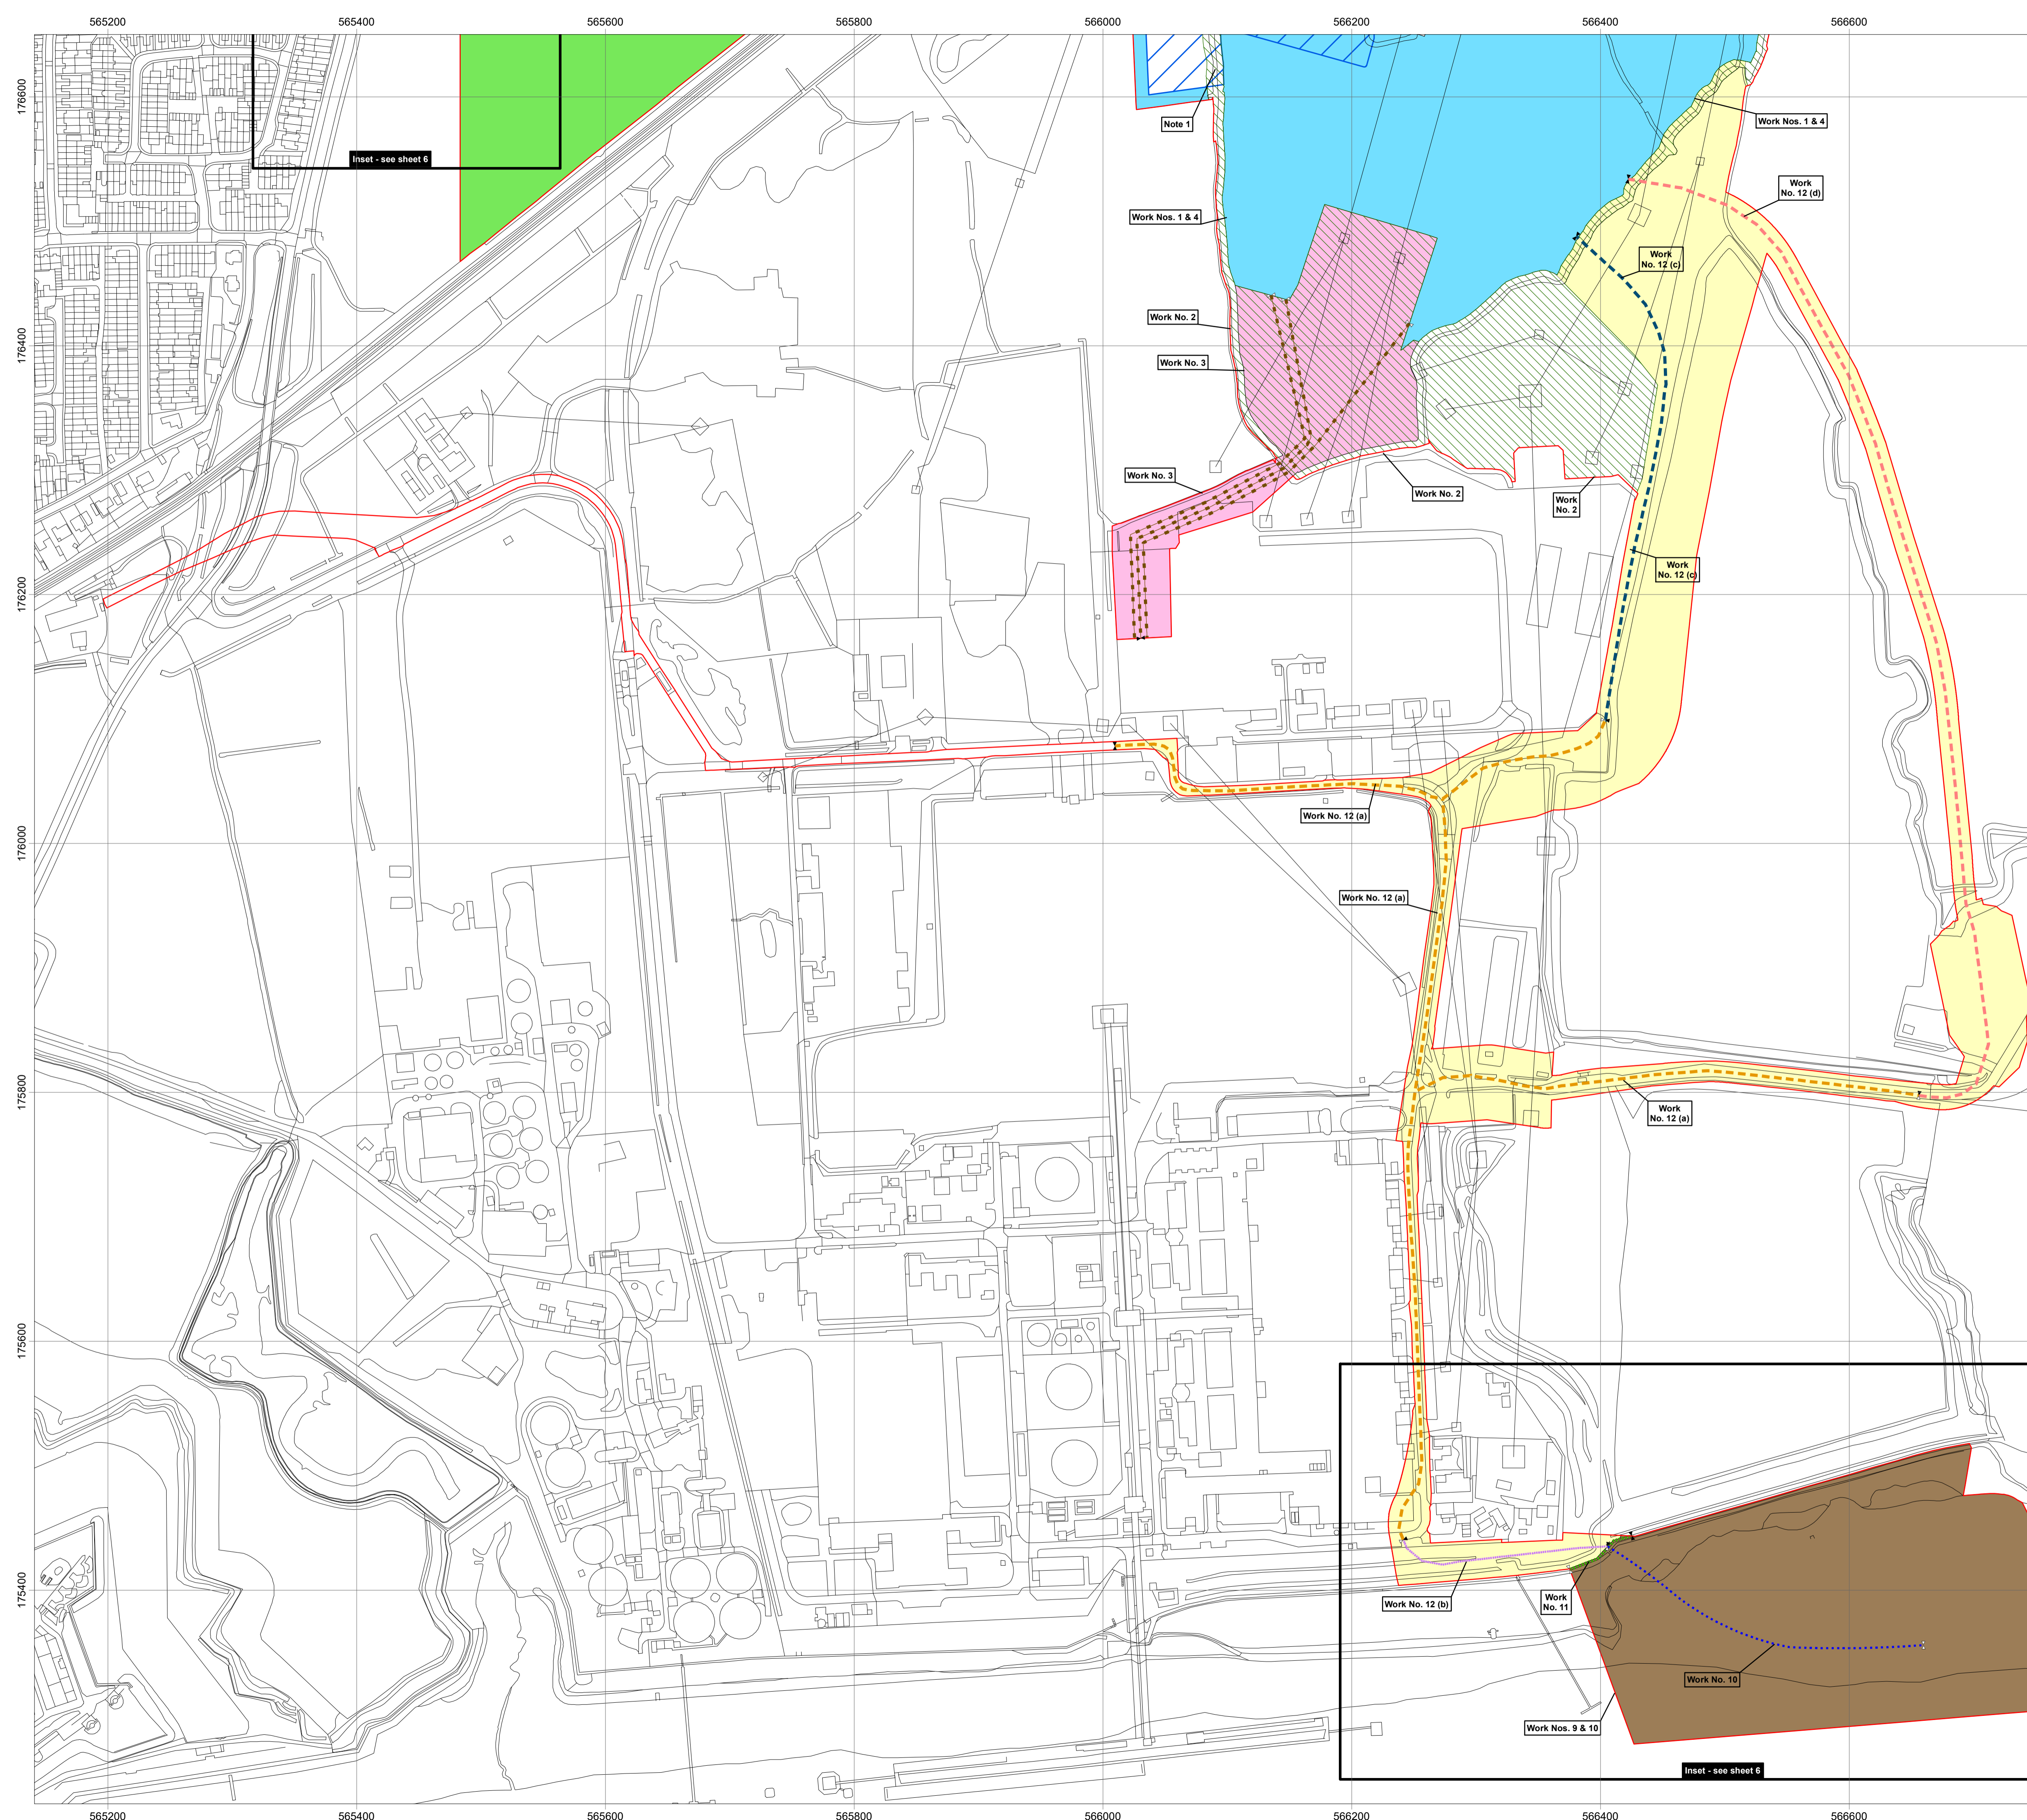

### Legend

- Order Limits
- Work No. 3A indicative centreline
- Work No. 10 indicative centreline
- Work No. 11
- Work No. 12 (a) indicative centreline
- Work No. 12 (b) indicative centreline
- Work No. 12 (c) indicative centreline
- Work No. 12 (d) indicative centreline
- Start of linear work
- End of linear work
- Co-terminus start of linear work and end of linear work
- Work No. 1 and Work No. 4 limit of deviation
- Work No. 2
- Work No. 3 limit of deviation
- Work No. 9 limit of deviation and Work No. 10 limit of deviation
- Work No. 12 limit of deviation
- Work No. 14
- Land for carbon capture readiness (CCR)

Note 1: Ditch to be retained unless CCR land is developed.

Date: 19/05/2020  
 Created by: MS  
 Checked by: TD  
 Doc no: 10872-0136-21  
 Scale: A1@ 1:2,500  
 Reference System: OSGB36  
 Projection: BNG




| Rev | Date | Remark |
|-----|------|--------|
|     |      |        |

APFP Regulations Reference: 5(2)(j)  
 Application Document Number: A2.3

**Thurrock Flexible Generation Plant  
 Work Plans  
 Sheet 4 of 6**





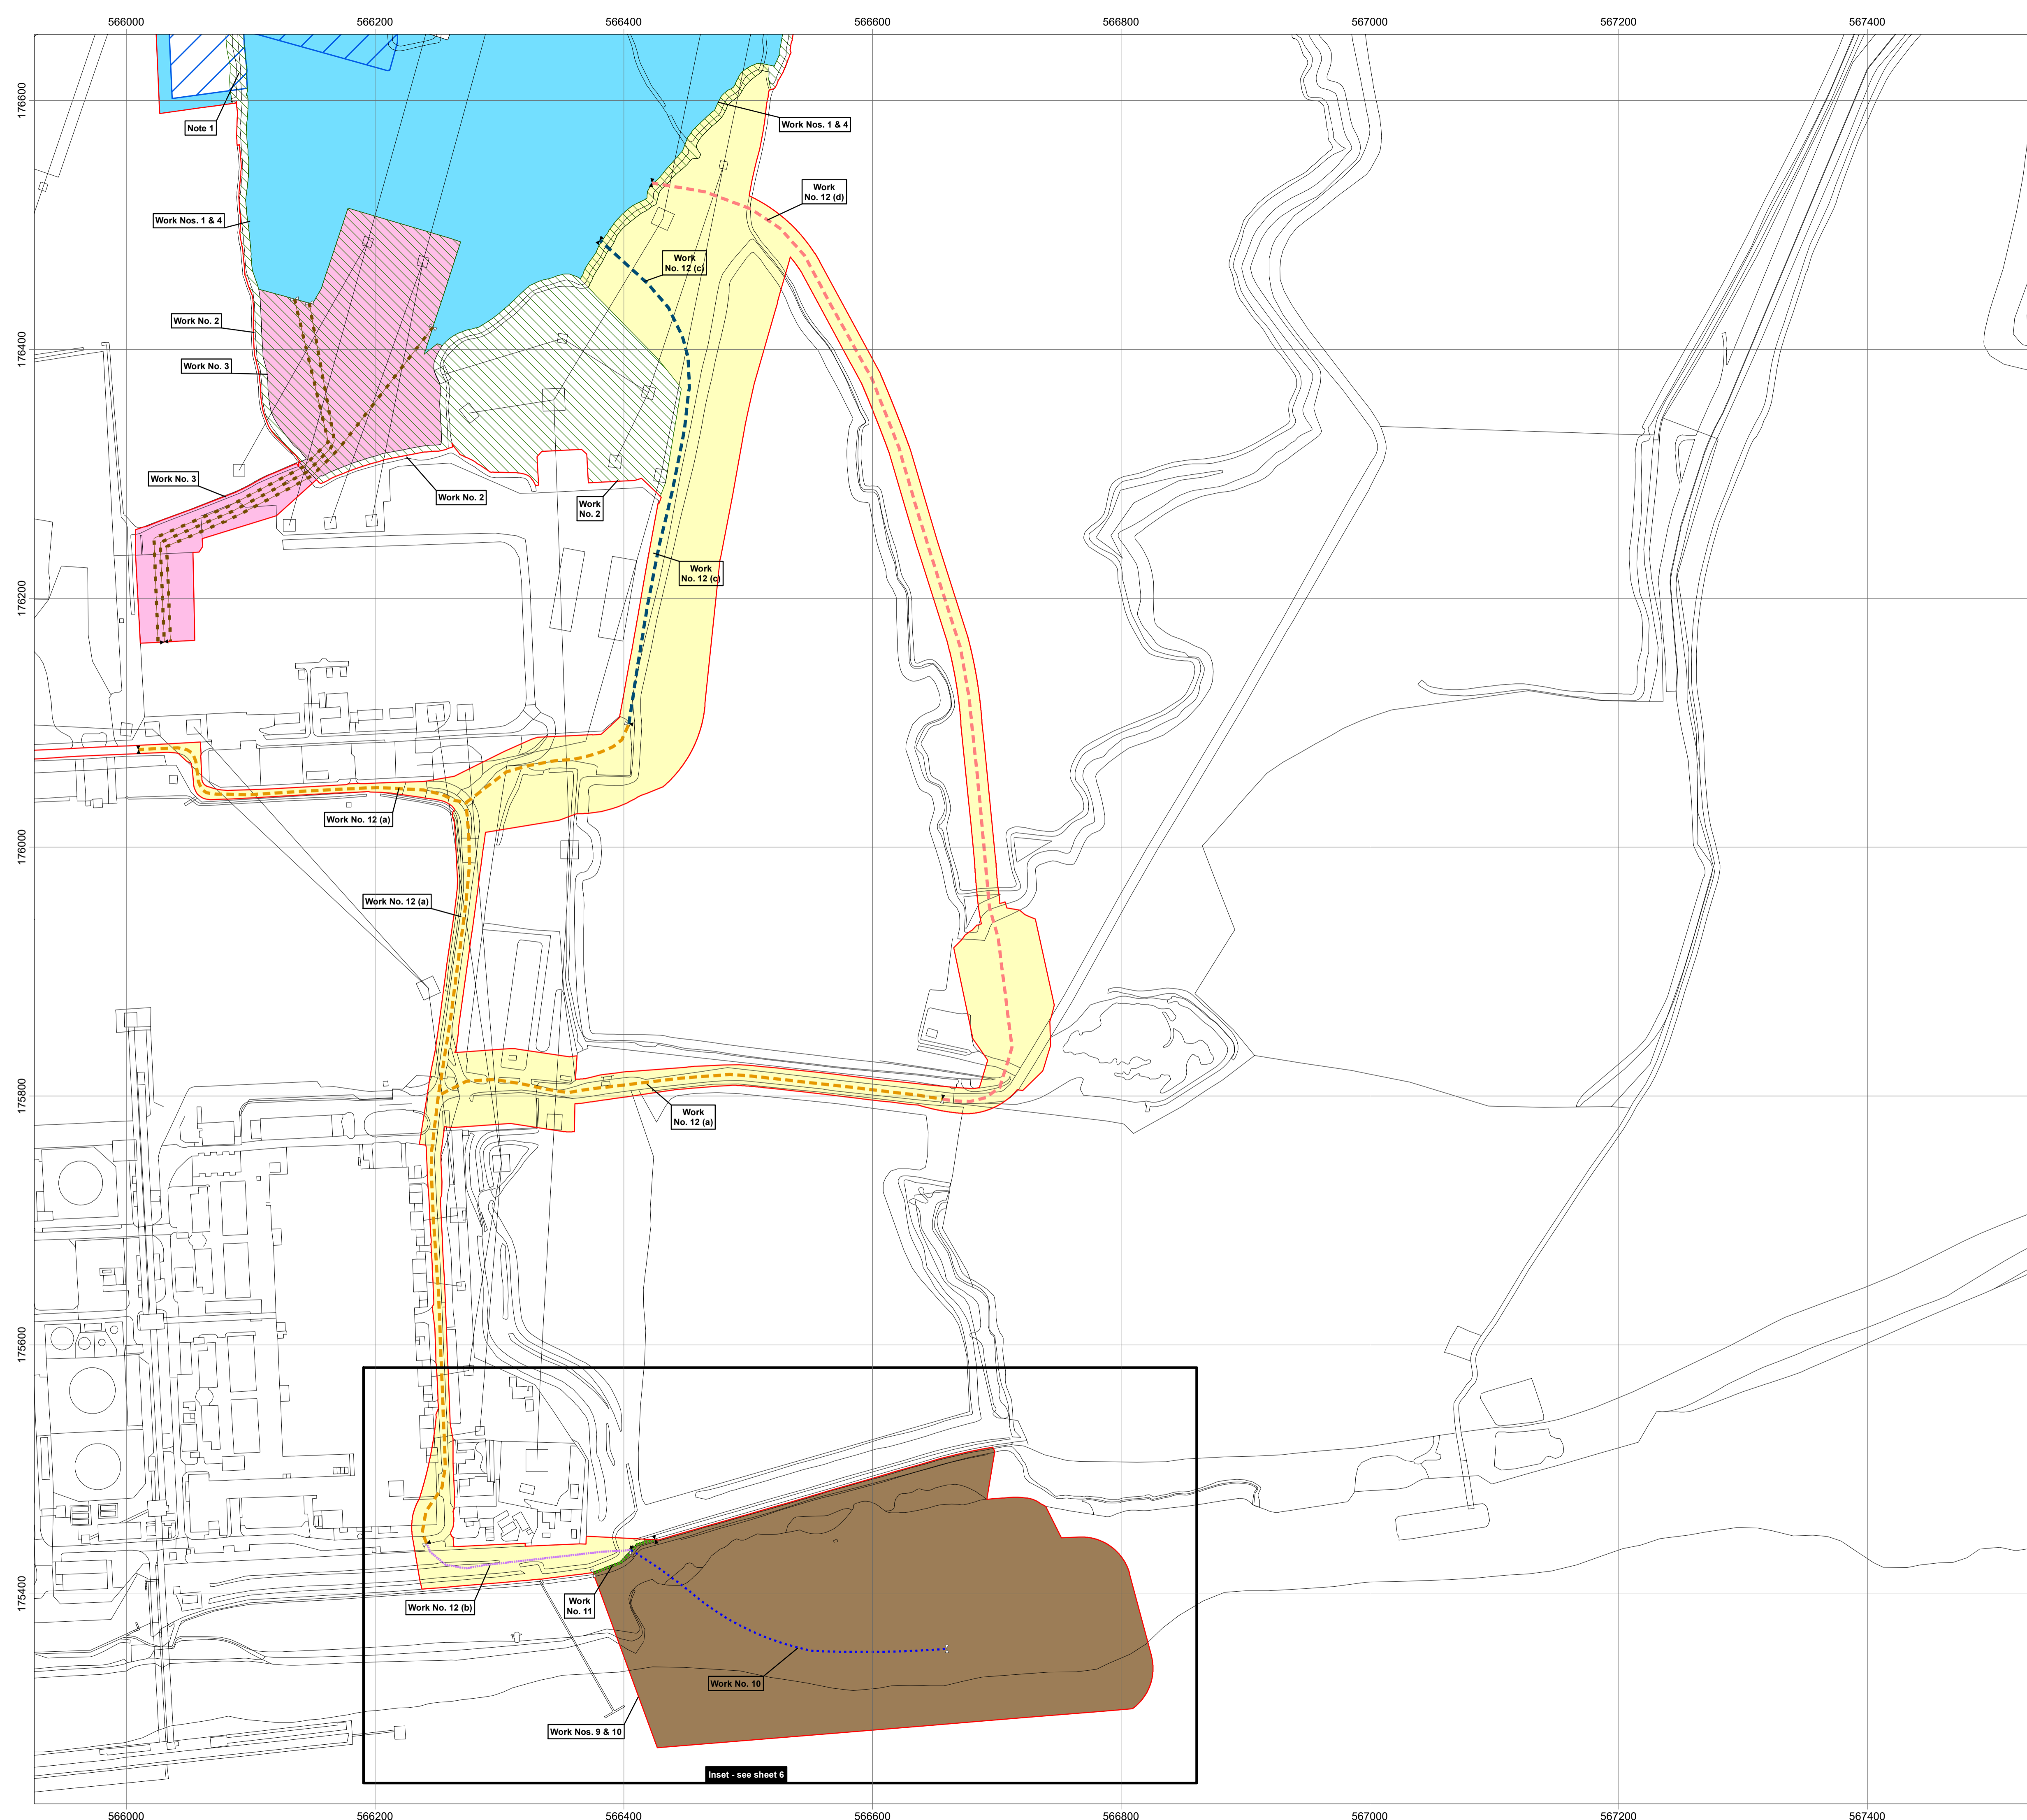

- ### Legend
- Order Limits
  - Work No. 3A indicative centreline
  - Work No. 10 indicative centreline
  - Work No. 11
  - Work No. 12 (a) indicative centreline
  - Work No. 12 (b) indicative centreline
  - Work No. 12 (c) indicative centreline
  - Work No. 12 (d) indicative centreline
  - Start of linear work
  - End of linear work
  - Co-terminus start of linear work and end of linear work
  - Work No. 1 and Work No. 4 limit of deviation
  - Work No. 2
  - Work No. 3 limit of deviation
  - Work No. 9 limit of deviation and Work No. 10 limit of deviation
  - Work No. 12 limit of deviation
  - Land for carbon capture readiness (CCR)

Note 1: Ditch to be retained unless CCR land is developed.

Date: 19/05/2020  
 Created by: MS  
 Checked by: TD  
 Doc no: 10872-0136-21  
 Scale: A1@ 1:2,500  
 Reference System: OSGB36  
 Projection: BNG



| Rev | Date | Remark |
|-----|------|--------|
|     |      |        |

APFP Regulations Reference: 5(2)(j)  
 Application Document Number: A2.3

**Thurrock Flexible Generation Plant**  
 Work Plans  
 Sheet 5 of 6

